

PRECAST TRANSFORMER PAD

UGS

REVISION: Updated Details, Tables & Format


CHECKED BY (ENGINEERING): SJ

DATE: 06/20/14

CHECKED BY (FIELD): DM

PREPARED BY: SJR

APPROVED BY: *Shen Mejia*

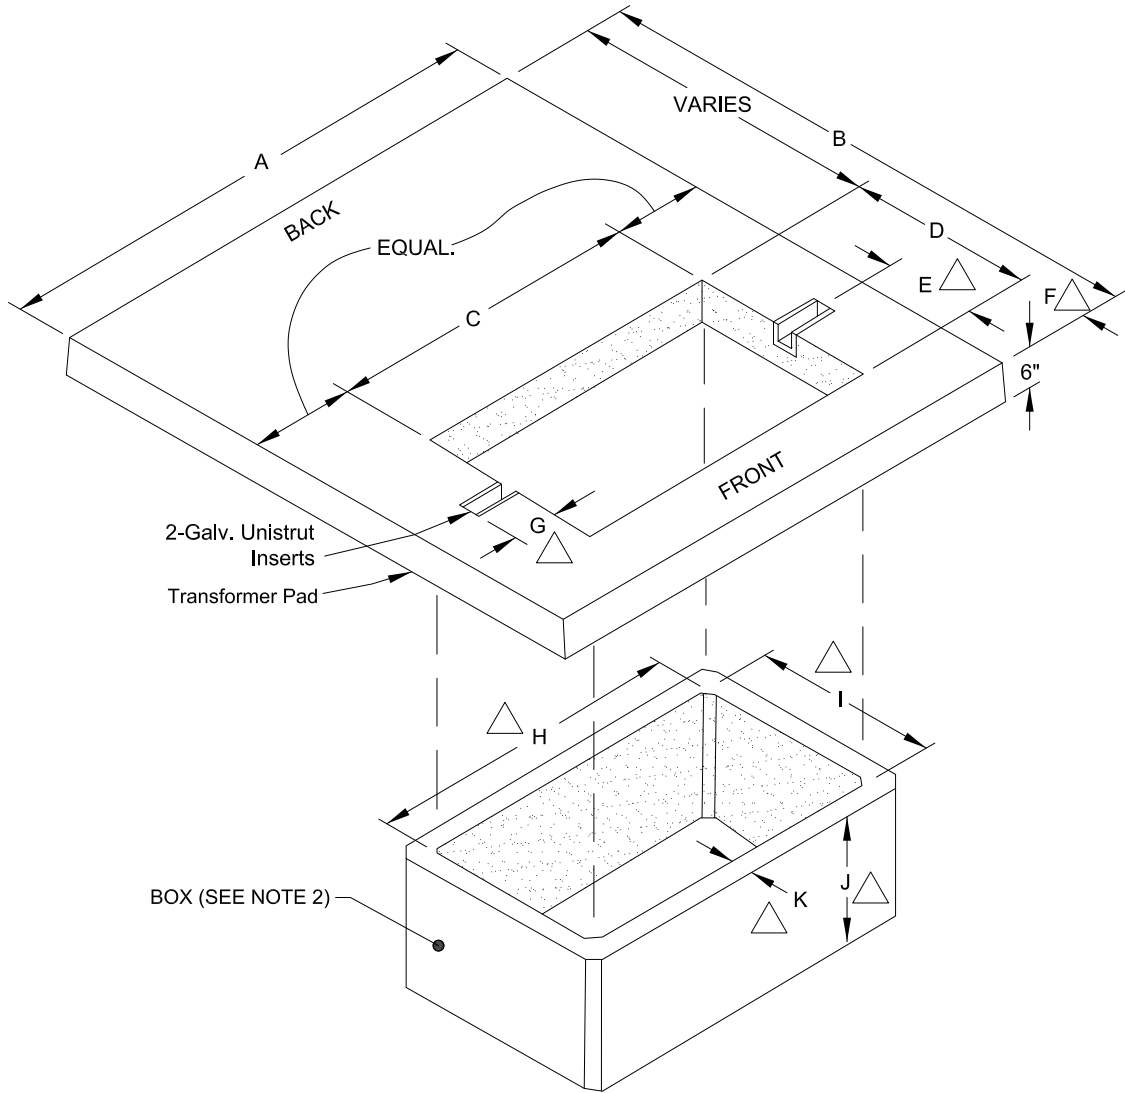

TP-3 (1Ø Xfmr.)	TP-5 (3Ø Xfmr.)	TP-7 (3Ø Xfmr.)
25 kVA	75 kVA	500 kVA
50 kVA	150 kVA	750 kVA
75 kVA	300 kVA	1000 kVA
100 kVA	-	1500 kVA
167 kVA	-	-

1. See UGS-621-A for Installation Details
2. Pad is to be Installed with or without box as specified on working drawings

Item No.	Dimensions-Inches											Manufacturer	Catalog No.	
	With Box	Pad						Box					Pad	Box
	A	B	C	D	E	F	G	H	I	J	K			
TP-3	48	54	26	18	9	6	6	30	17	12	1-1/4	Jensen Precast	PD4854-T6-21	30-15-50
												J&R Concrete	TP-4854	E-6B
												Oldcastle	ED-4854-6	E-6B
TP-5	72	66	38	18	7	6	6	42	20	12	1-1/2	Jensen Precast	PD6672-T6-21	E-7-1/2
												J&R Concrete	TP-6672	E-7-1/2
												Oldcastle	ED-6672-6	
TP-7	94	72	50	18	6	7	14	48	30	14	1-1/2	Jensen Precast	PD7294-T6-21	
												J&R Concrete	TP-7294	E-8
												Oldcastle	ED-7294-6	