
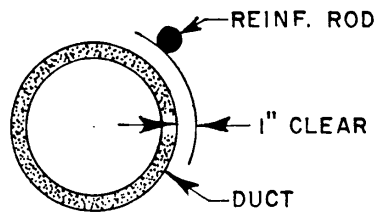




DUCT BEAM REINFORCEMENT

2-1-67

RIVERSIDE PUBLIC UTILITIES DEPT.—UNDERGROUND STRUCTURES

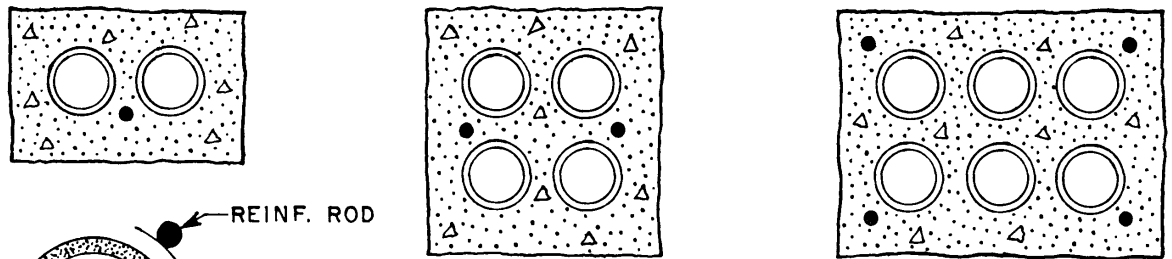

TYPICAL

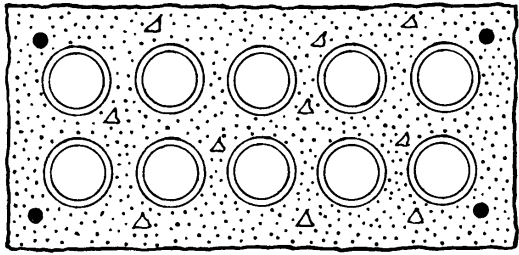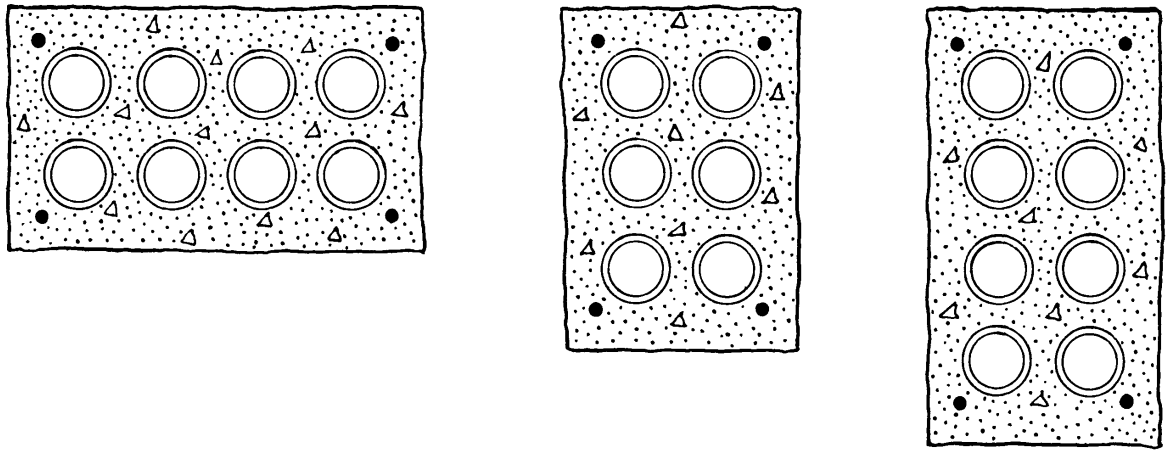

SHOWN ARE TYPICAL DUCT BEAMS
 WITH PLACEMENT OF REINFORCING
 WHEN SPECIFIED ON WORKING DRAWING.
 ALL REINFORCING ROD TO BE 3/8"Ø
 WITH 15" OVERLAP AT ENDS.